
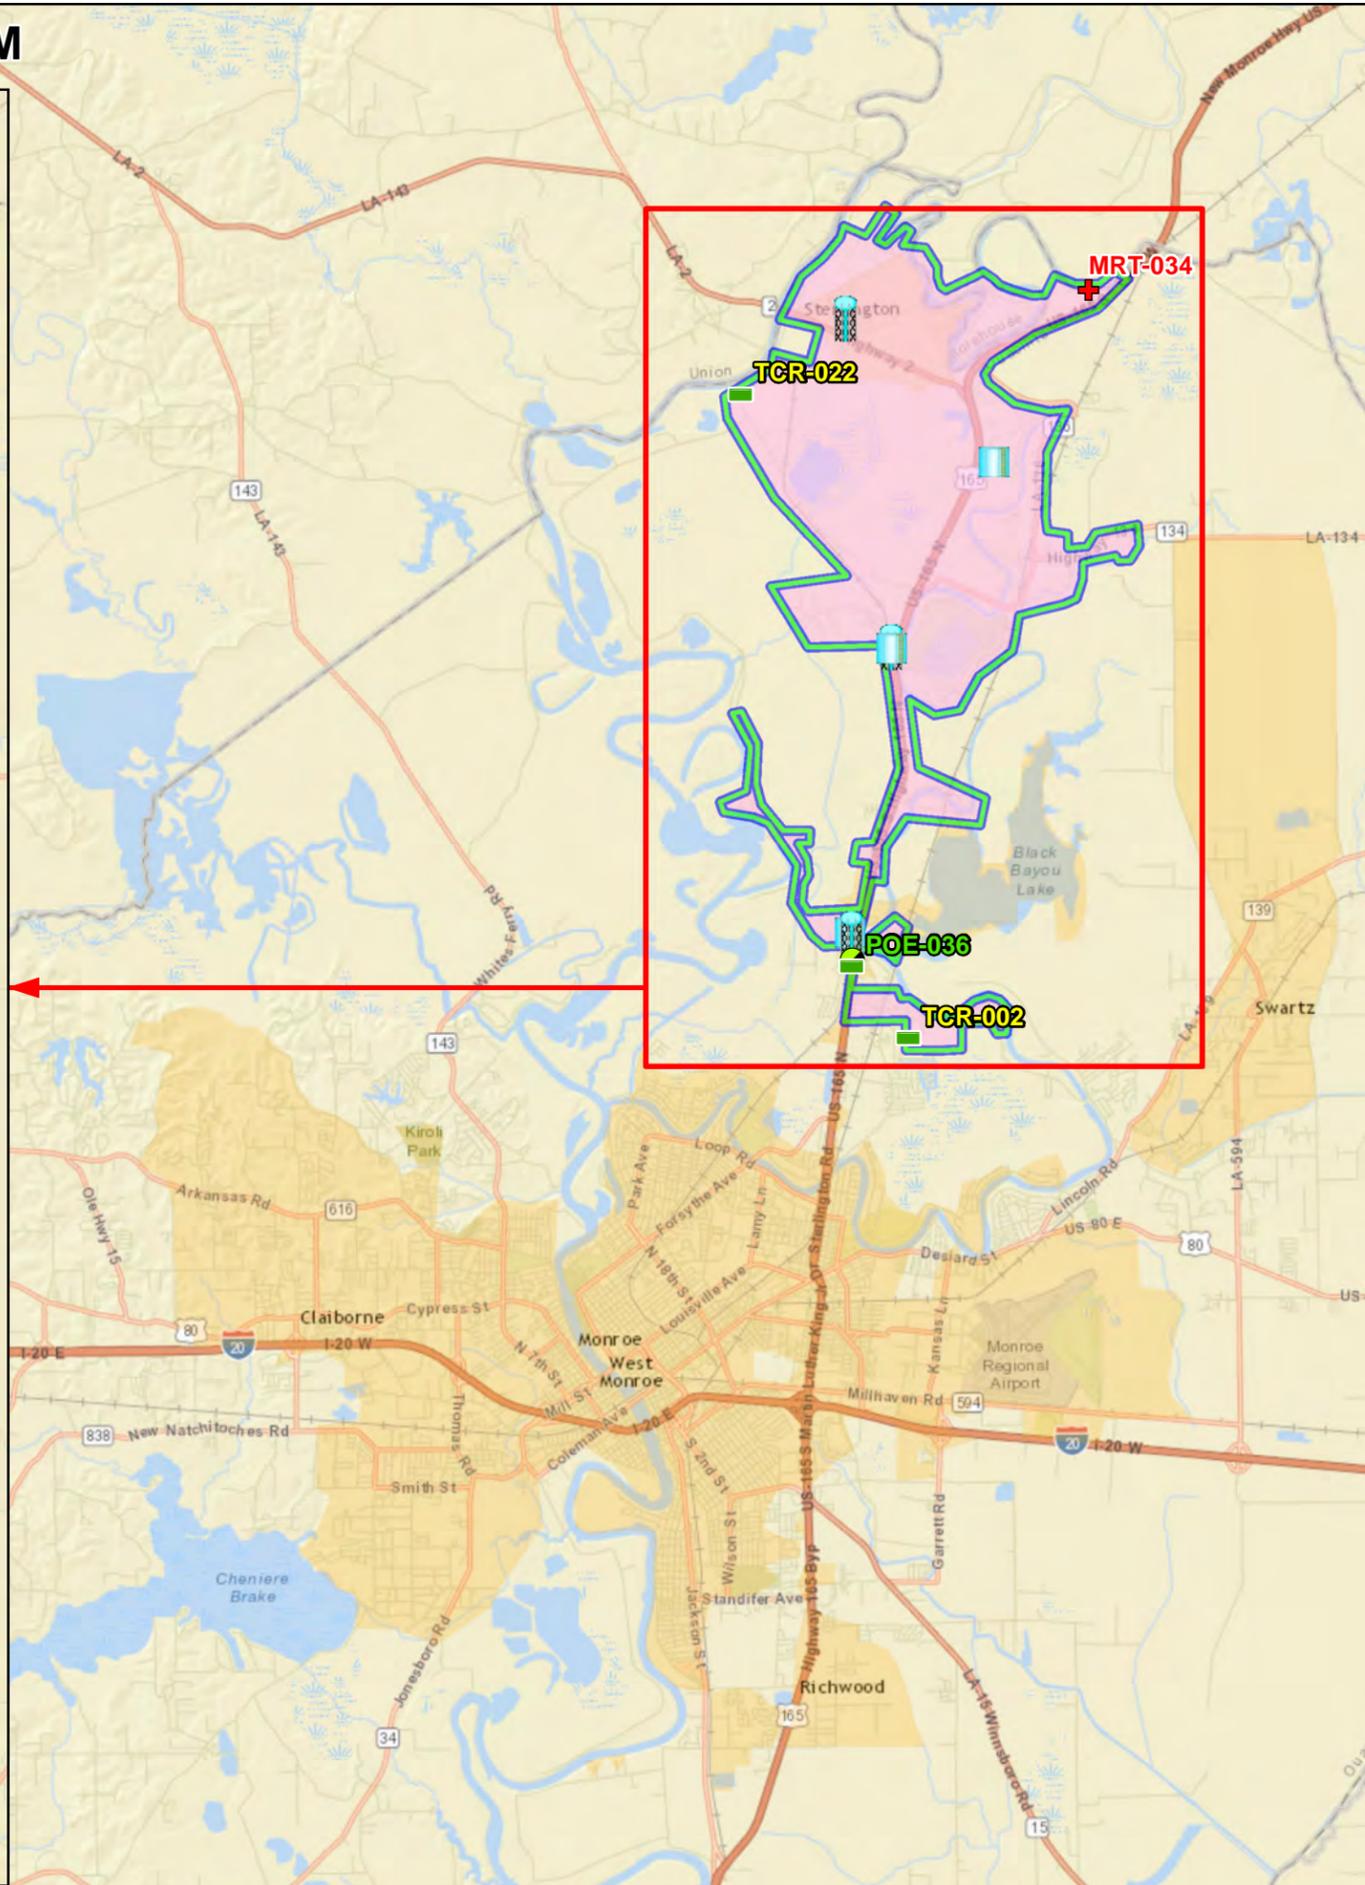


LA1073035 - NORTH MONROE ET AL WATER SYSTEM

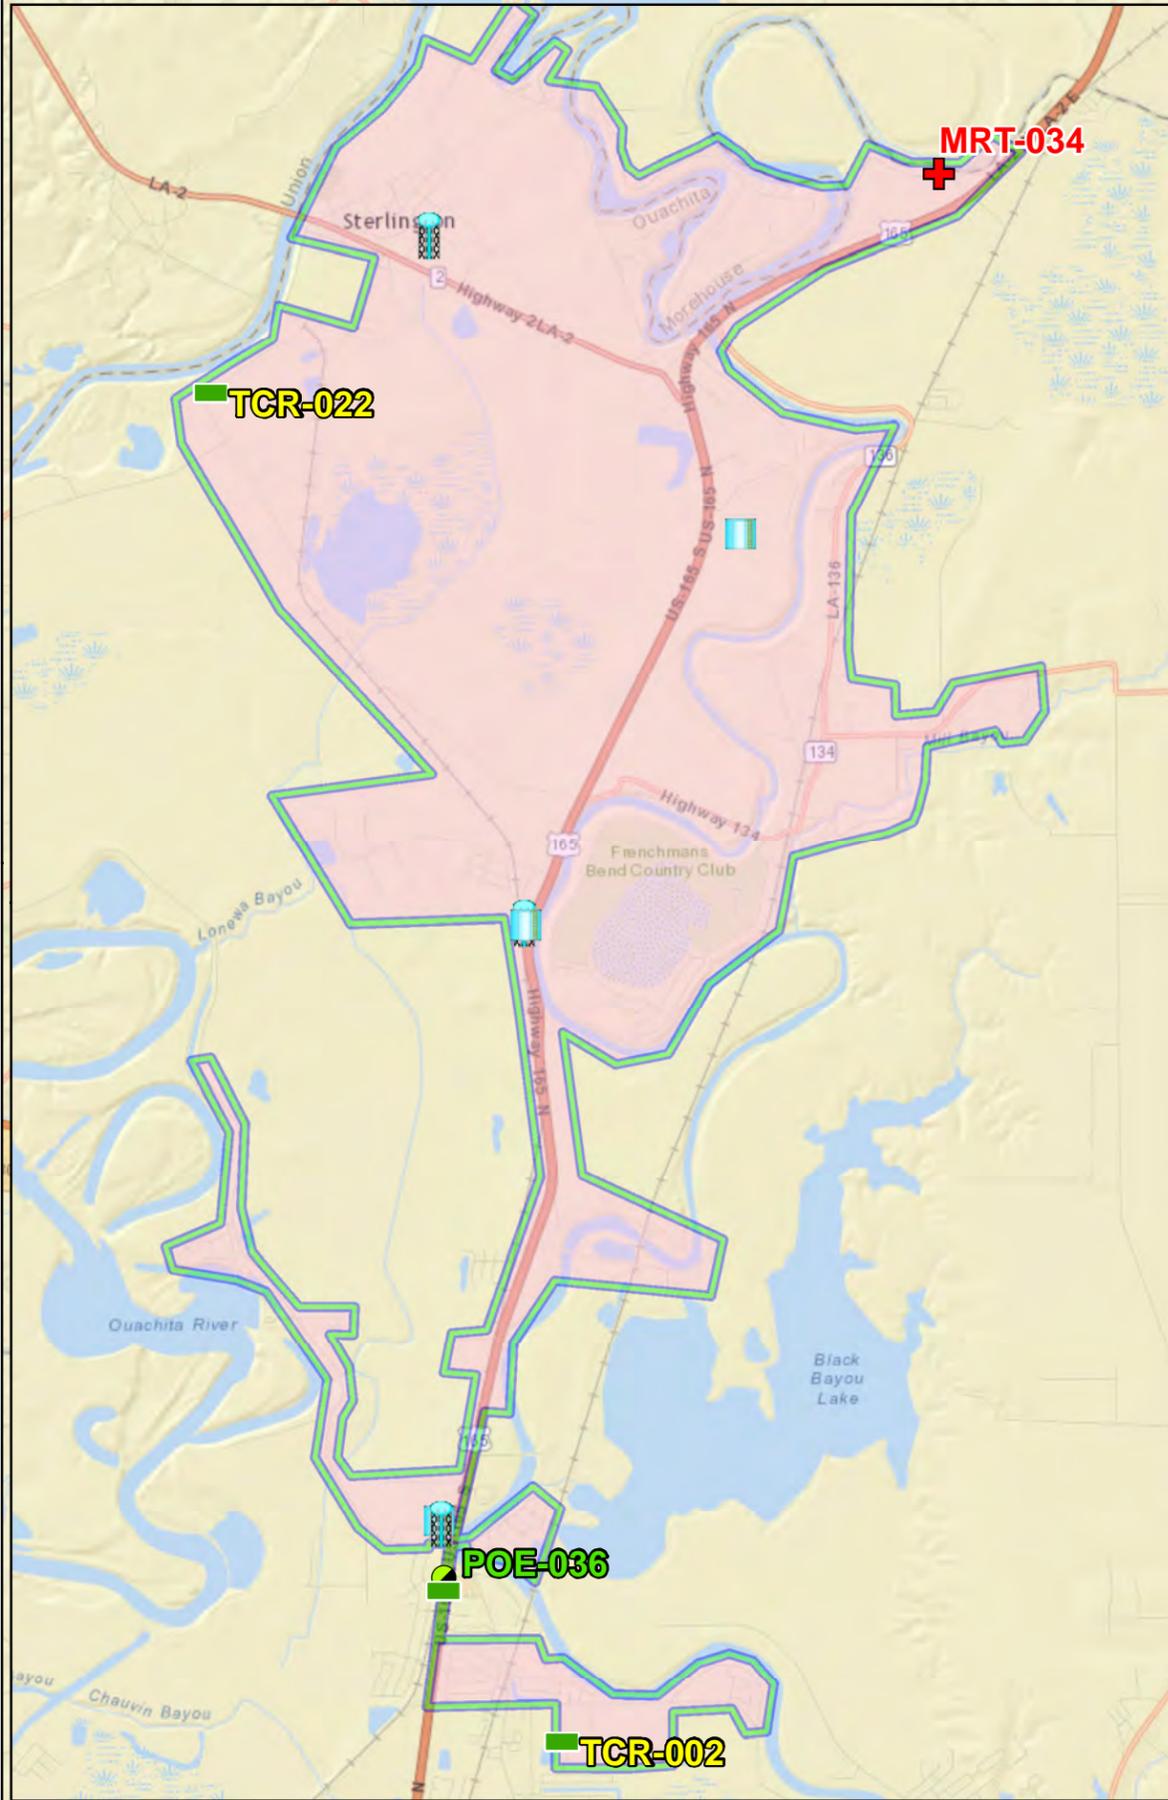

Statewide ameoba sampling
01 Sep 2015

Legend

- Monitoring sites with Nf Negative
- + Monitoring sites with Nf Positive

System Facilities

- Consecutive Connection
- Elevated tank
- Ground tank
- PWS Service area
- Populated Places

0 1 2 Miles

1 in = 2 miles

NAD83 UTM Zone 15N

This document may only be reproduced in its entirety.
Questions may be directed to:
Engineering Services Section
Louisiana Department of Health and Hospitals
Office of Public Health
Telephone: 225.342.7499

